

Applies to HE and HE+ models

Note:

Warranty does not cover damage to freezing. The unit may be drained manually. However, Rinnai highly recommends that drain down solenoid valves be installed that will automatically drain if power is lost. Rinnai also recommends the installation of a surge protector with terminals that attaches to the PC board in the unit and allows the solenoid valves to operate if the unit is disabled due to an error code. When electrical power to the water heater fails, the normally closed solenoid valve closes (stopping the flow of water into the heater) and the normally open solenoid valve opens (allowing the heater and associated piping to drain). Ensure that the drain for the solenoids runs to the outside environment to prevent discharging water inside the building causing water damage.

Note:


For lowest activation flow rate, ensure water heaters are connected with appropriate cascade controls.

Note:

Heat trace ALL water pipe and fittings located outside home, attic, crawl space, or building structure (ALL water pipe and fittings above dashed line in drawing).

Note:

ALL pipe and fittings shown below dashed line should be located inside home or building structure. The vacuum breaker line should be located in the building structure.

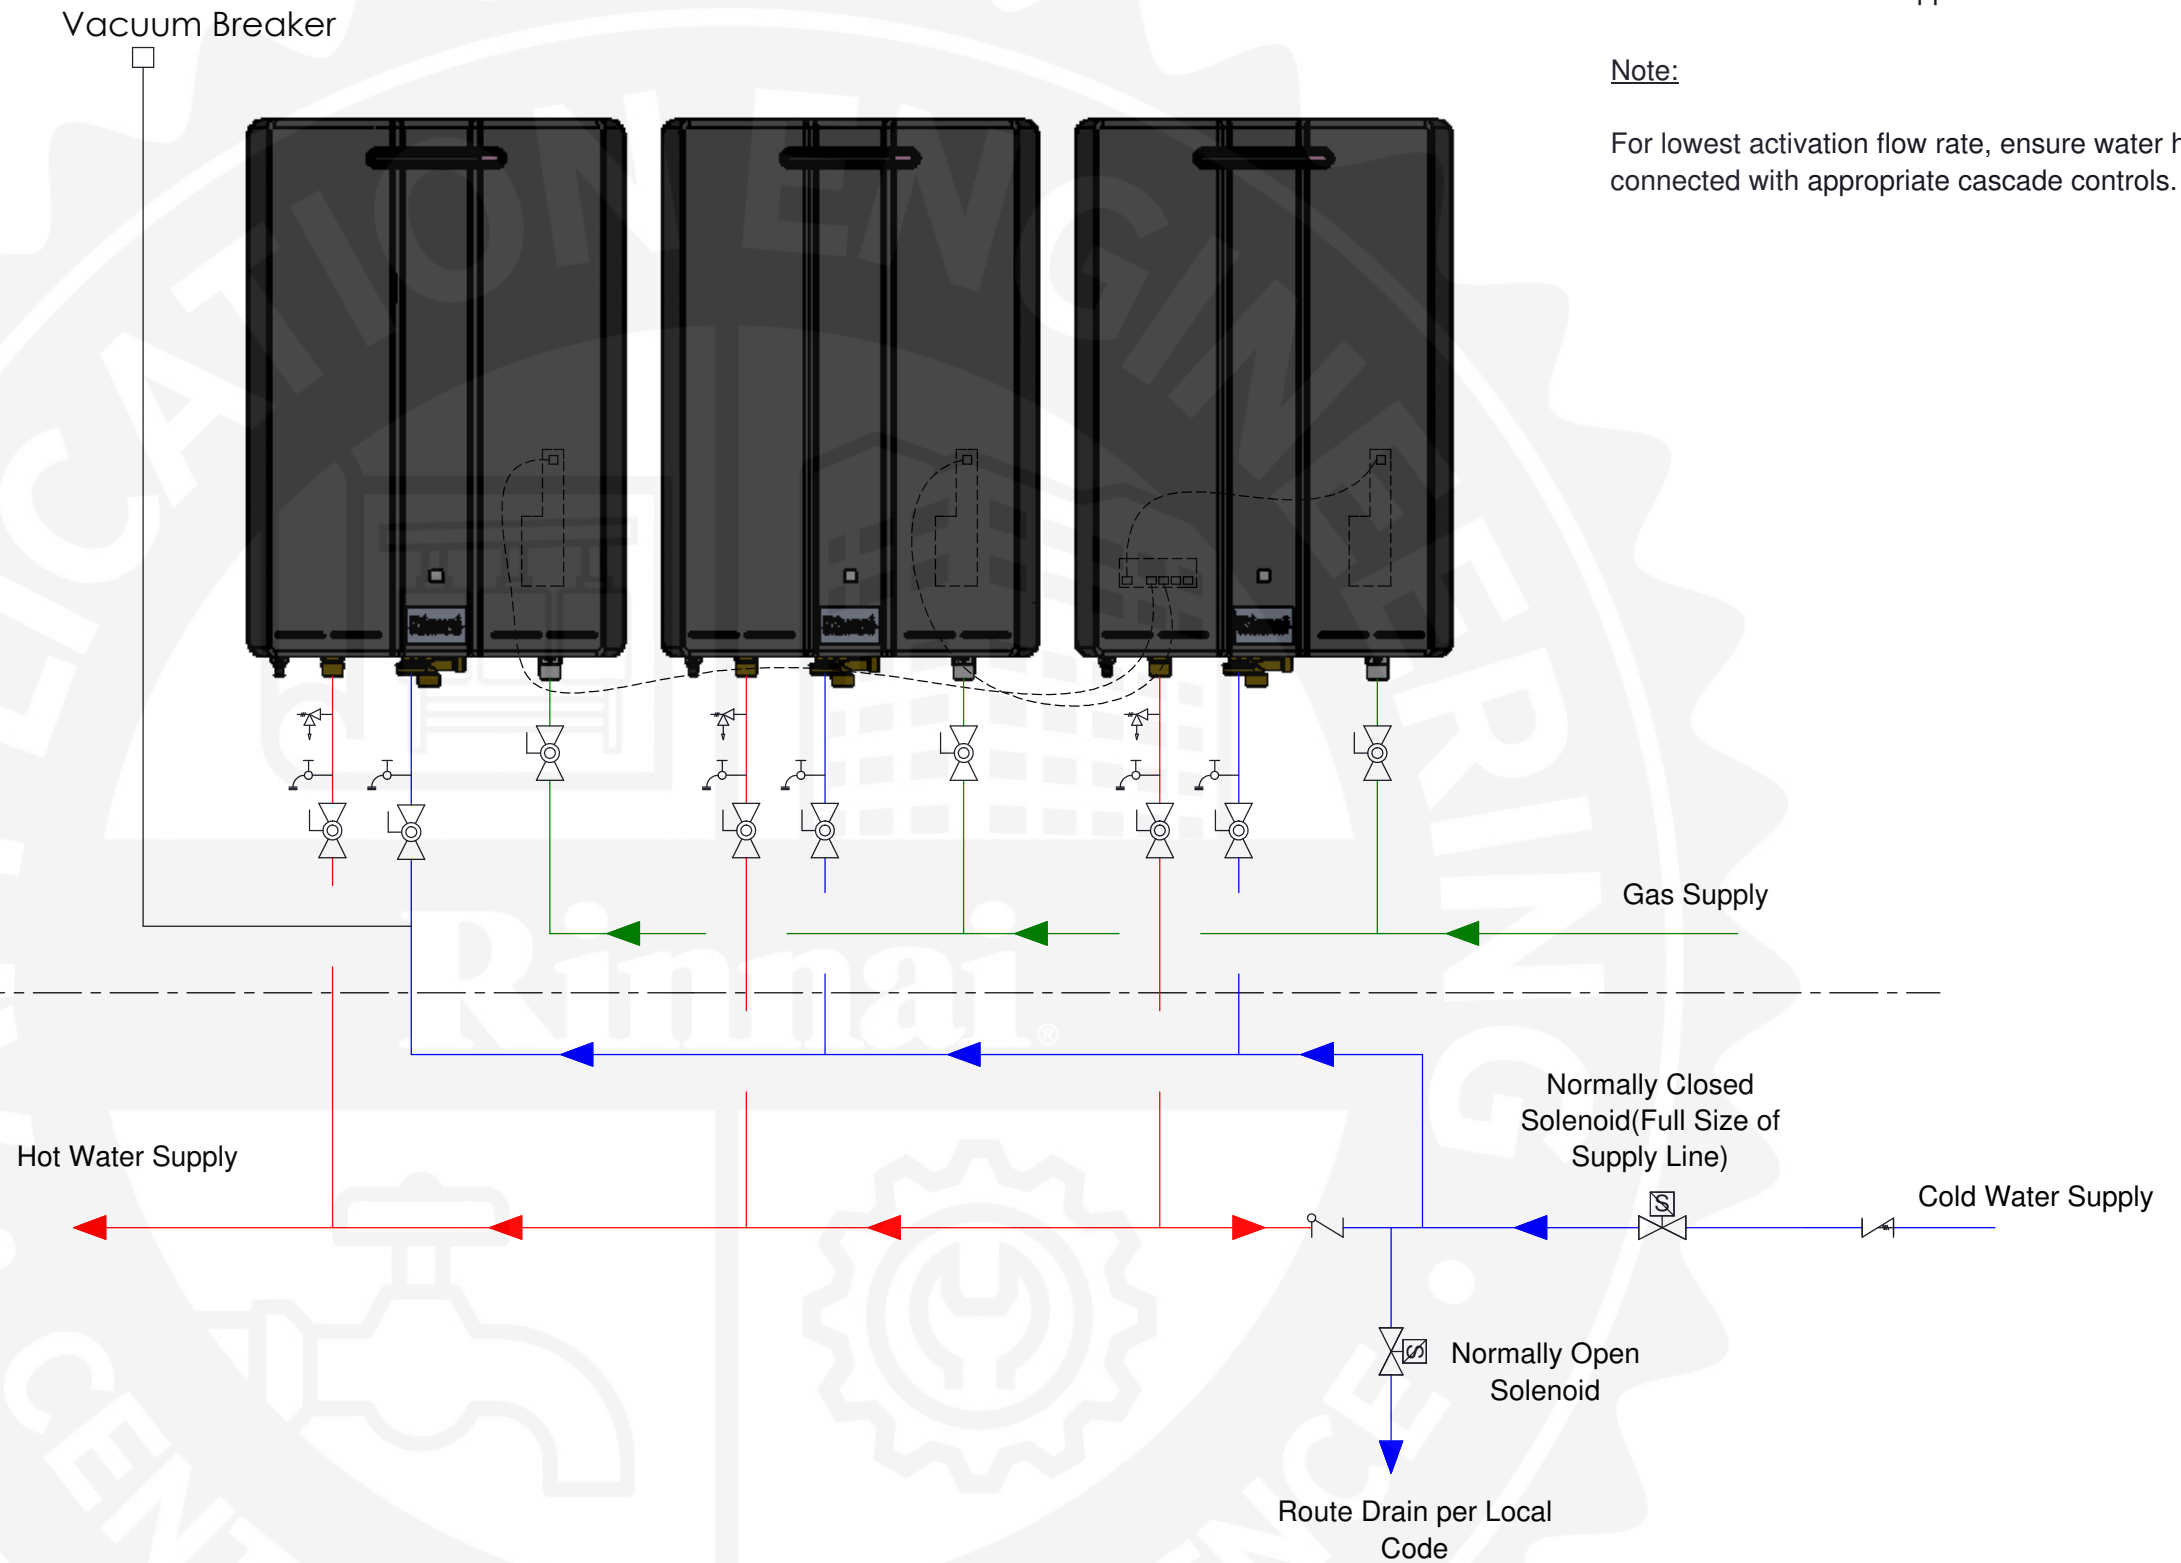

This is not an engineering drawing; it is intended only as a guide and not as a replacement for professional engineering project drawings. This drawing is not intended to describe a complete system. It is up to the contractor or engineer to determine the necessary components and configuration of the particular system to be installed. The drawing does not imply compliance with local building code requirements. It is the responsibility of the engineer or contractor to ensure that the installation is in accordance with all local building codes. Confer with local building officials before installation.

UNLESS OTHERWISE SPECIFIED:

TOLERANCES:
 Sheet Metal X.XX = ±0.030
 X.XXX = ±0.010
 Fraction = ±1/32
 Angle = ± 1.0°
 MACHINED X.XXX = ±0.005
 Angle = ± 0.010°

INTERPRET GEOMETRIC TOLERANCING PER:

MATERIAL

FINISH

DO NOT SCALE DRAWING

NAME	DATE
AB	11.16.2018
SH	12.15.2018
RS	12.15.2018

DRAWN

CHECKED

ENG APPR.

COMMENTS:

RINNAI AMERICA CORPORATION
 103 INTERNATIONAL DRIVE
 PEACHTREE CITY, GA 30269
 1-800-621-9419

PROPRIETARY AND CONFIDENTIAL

THE INFORMATION CONTAINED IN THIS DRAWING IS THE SOLE PROPERTY OF RINNAI AMERICA. ANY REPRODUCTION IN PART OR AS A WHOLE WITHOUT THE WRITTEN PERMISSION OF RINNAI AMERICA IS PROHIBITED.

Rinnai

TITLE:
Systems Design Manual

Rinnai Tankless
 3 Unit Freeze Protection

SIZE	DWG. NO.	REV
B	WH3-D	

SCALE: NTS	WEIGHT:	SHEET 1 OF 1