

PURPOSE: The purpose of this document is to communicate a means of configuring the Rinnai Hydronic Air Handler to have differing blower speeds for heating and cooling.

PRODUCT INFORMATION

- Applicable Product: Rinnai Air Handler
- Applicable Models Listed Below:

With Internal Circulation Pump	Without Internal Circulation Pump
<ul style="list-style-type: none">• AH083CP• AH084CP• AH125CP• AH166CP• AH206CP	<ul style="list-style-type: none">• AH083P• AH084P• AH125P• AH166P• AH206P


DETAILS

The Rinnai Air Handler has different blower speeds for heating and cooling that can be adjusted via a relay (pictured below). When changing fan motor speeds, installers should ensure the capabilities of the air handler meet the needs of the system.

Refer to the Rinnai Hydronic Air Handler Installation and Operation Manual for more information on setting speeds.



White Rodgers 90-3708 or equivalent
Single Pole Double Throw Relay

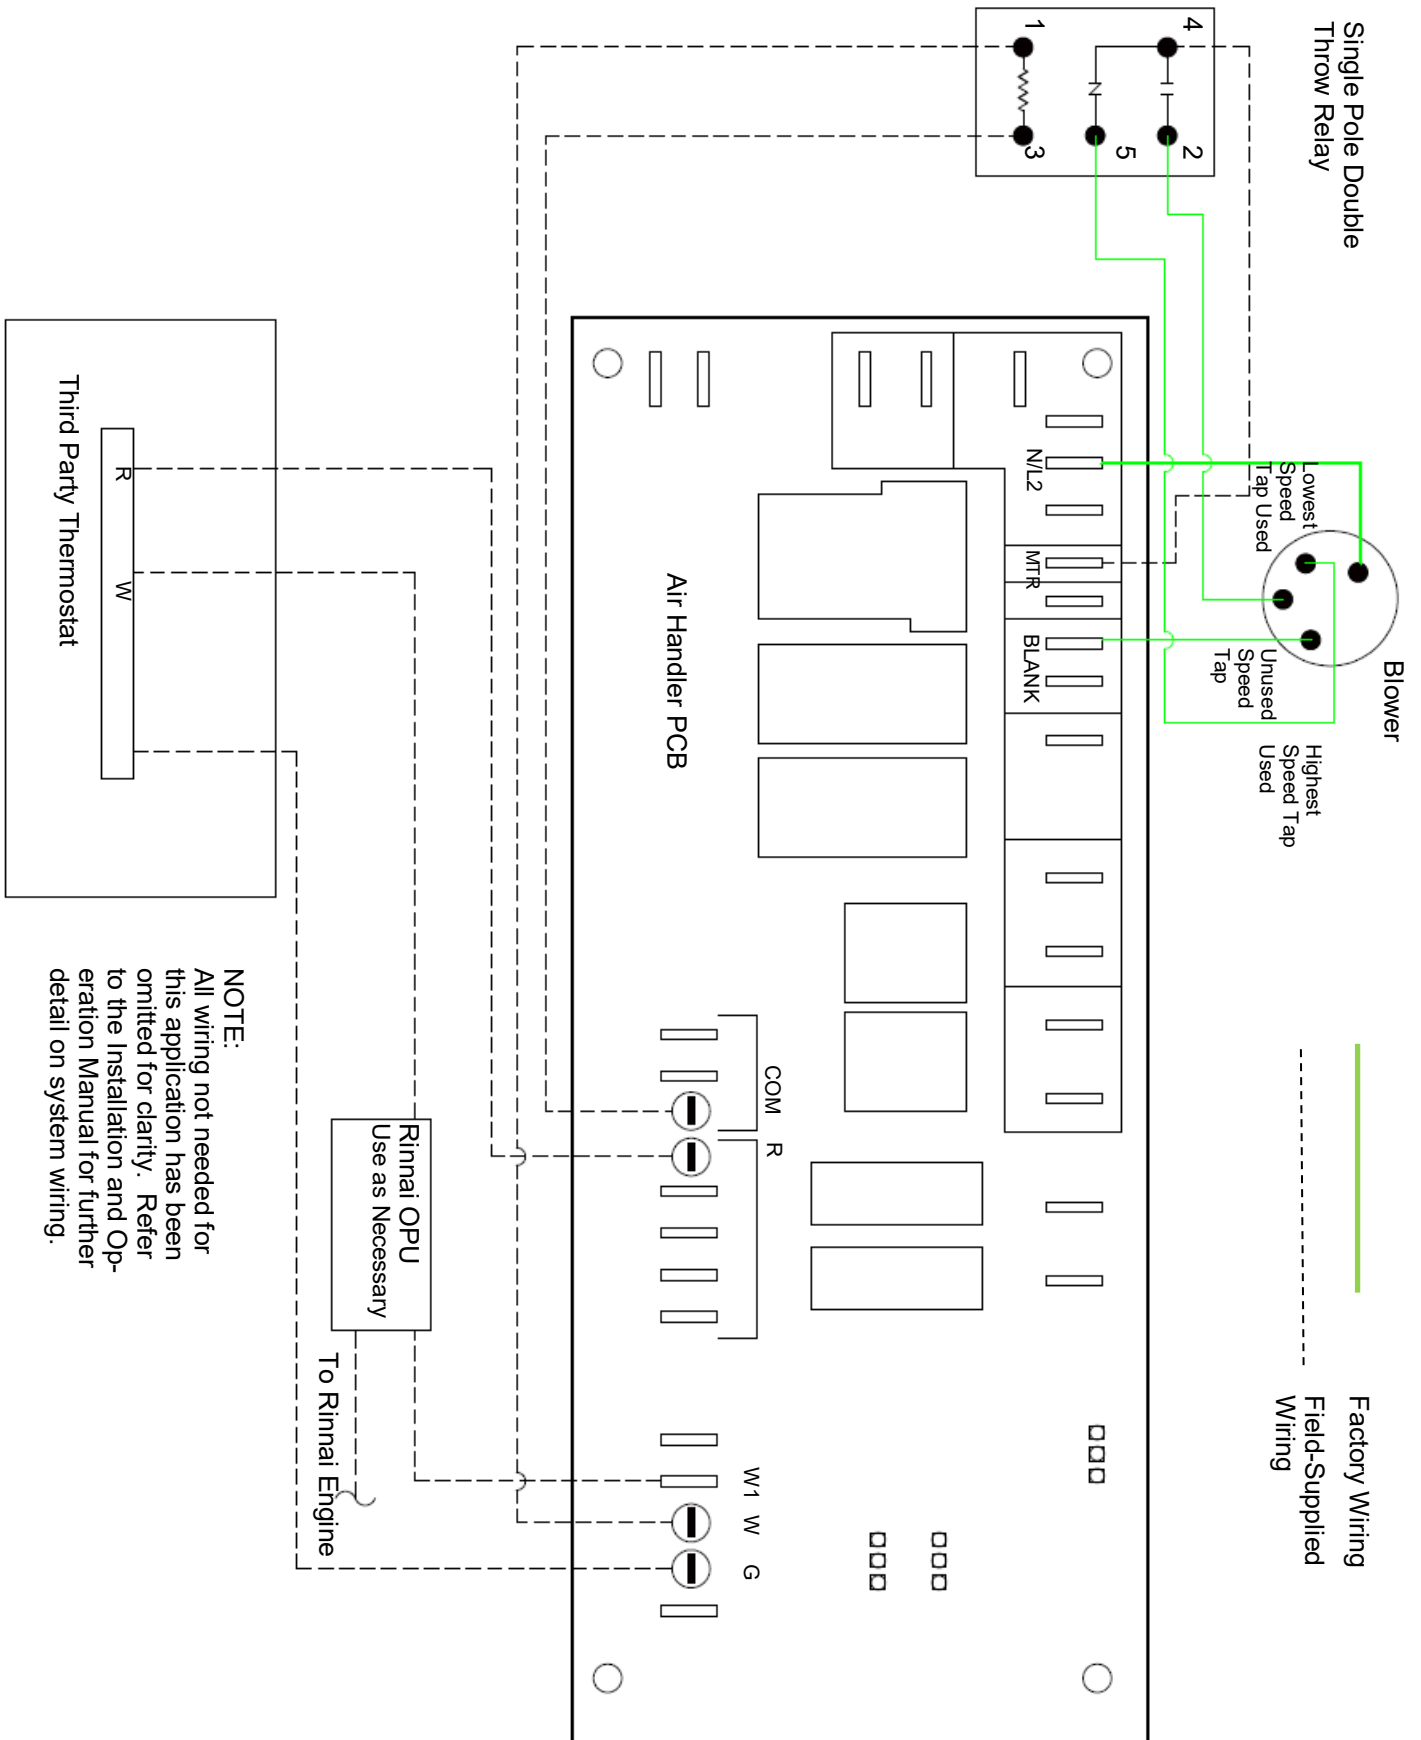

NOTE:
 All wiring not needed for this application has been omitted for clarity. Refer to the Installation and Operation Manual for further detail on system wiring.