

Builder's Specification

R85e (REU-V2532W)

Type of Appliance	Temperature controlled, continuous flow, gas hot water system	
Minimum/Maximum Gas Rate (Input)	15,000 - 199,000 BTU/h (Natural Gas or Propane)	
Electrical	Appliance:	AC 120 Volts - 60 Hz
	Remote Control:	DC 12 Volts
Electrical Consumption	Normal	63 watts
	Standby	5.5 watts
	Anti-frost protection	84 watts
Ignition System	Direct electronic ignition	
Hot Water Capacity	0.6 to 6.5 GPM (50° F rise)	0.6 to 8.5 GPM (35° F rise)
Approved Gas Types	Natural or Propane (ensure unit matches gas type)	
Service Connections	Gas supply: 3/4 inch MNPT Cold water inlet: 3/4 inch MNPT Hot water outlet: 3/4 inch MNPT	
Minimum/Maximum Water Supply Pressure	20 - 150 PSI (50 PSI or above is recommended for maximum flow)	
Remote Control Cable	Non-polarized two-core cable (low voltage wire; 16 gauge solid core recommended)	
Remote Controls	MC-91-1US (included) Deluxe controller: MC-100V-1US (optional) Bathroom controller: BC-100V-1US (optional) Wireless controller: MS-502-RC-1US-MS (optional)	
Clearances from combustibles	• Top of heater - 12 inches • Front (Panel) - 24 inches • Front (Exhaust) - 24 inches • Back of heater - 0 inches • Bottom of heater - 12 inches • Sides of heater - 6 inches	
Clearances from non-combustibles	• Top of heater - 2 inches • Front (Panel) - 0 inches * • Front (Exhaust) - 24 inches • Back of heater - 0 inches • Bottom of heater - 2 inches • Sides of heater - 1/8 inch	
* 24 inches required for serviceability		
Min. / Max. Gas Supply Pressure	Natural Gas: min 6" W.C.	max 10.5" W.C.
	Propane Gas: min 10" W.C.	max 13.5" W.C.

ACCESSORIES

MSA Controller: for multiple unit installations

Pipe Cover: for finished look

Recess Box: protects and hides the unit from view

Rinnai Installation Kit (RIK): provides isolation valves, pressure relief valve, and full port drains with easy union installation.

Rinnai is continually updating and improving products; therefore, specifications are subject to change without prior notice. Local, state, provincial and federal codes must be adhered to at installation.

These specification are provided for planning purposes. Refer to the Operation / Installation Manual for additional information.


WARRANTY

Warranty is reduced if used as a circulating water heater within a hot water circulation loop, where the water heater is in series with a circulation system and all circulating water flows through the water heater, and where an on-demand recirculation system is not incorporated. Refer to the Operation / Installation manual for complete details.


Lime buildup is not covered by the warranty. Treat or condition if necessary. Refer to the Operation / Installation manual for water quality target levels.

Damage due to freezing is not covered by the warranty. Rinnai highly recommends auto drain down solenoid valves to protect the unit from freeze damage if there is a power outage.

DIMENSIONS

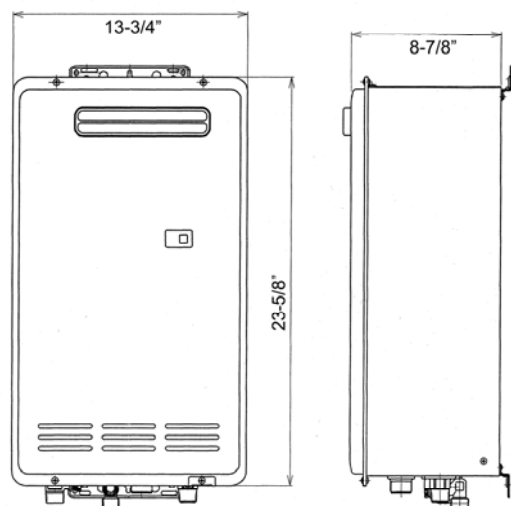


WEIGHT: 46 LBS

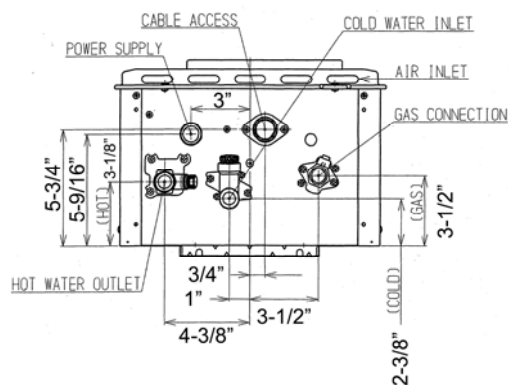

The wall mounting bracket allows offsets the unit from the wall 0.6 inches (15 mm).

CLEARANCES

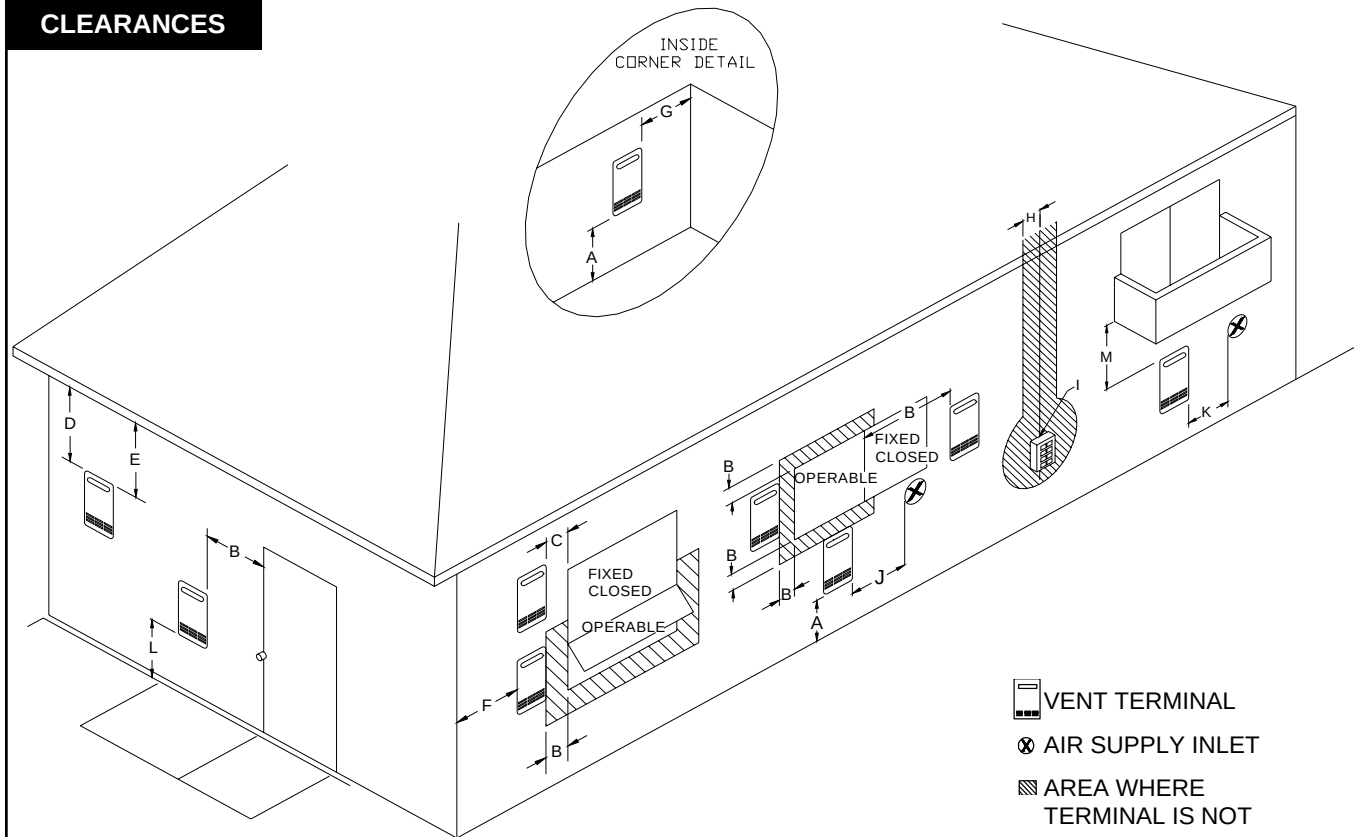

Follow the clearances below required by ANSI Z223.1 and the recommended clearances on the next page.

Maintain 12 inch clearance above the highest anticipated snow level or grade, or whichever is greater. Please refer to your local codes for the snow level in your area.

Ref	Description	Canadian Installations	US Installations
A	Clearance above grade, veranda, porch, deck, or balcony	12 inches (30 cm)	12 inches (30 cm)
B	Clearance to window or door that may be opened	36 inches (91 cm)	12 inches (30 cm)
C	Clearance to permanently closed window	*	*
D	Vertical clearance to ventilated soffit, located above the terminal within a horizontal distance of 2 feet (61 cm) from the center line of the terminal	*	*
E	Clearance to unventilated soffit	*	*
F	Clearance to outside corner	*	*
G	Clearance to inside corner	*	*
H	Clearance to each side of center line extended above meter/regulator assembly	3 feet (91 cm) within a height 15 feet (4.5 m) above the meter/regulator assembly	*
I	Clearance to service regulator vent outlet	36 inches (91 cm)	*
J	Clearance to nonmechanical air supply inlet to building or the combustion air inlet to any other appliance	36 inches (91 cm)	12 inches (30 cm)
K	Clearance to a mechanical air supply inlet	6 feet (1.83 m)	3 feet (91 cm) above if within 10 feet (3 m) horizontally
L	Clearance above paved sidewalk or paved driveway located on public property	7 feet (2.13 m) ①	*
M	Clearance under veranda, porch, deck, or balcony	12 inches (30 cm) ②	*

① A vent shall not terminate directly above a sidewalk or paved driveway that is located between two single family dwellings and serves both dwellings.

② Permitted only if veranda, porch, deck, or balcony is fully open on a minimum of two sides beneath the floor.

* For clearances not specified in *ANSI Z223.1/NFPA 54* or *CSA B149.1*, clearances are in accordance with local installation codes and the requirements of the gas supplier.

These clearances are to supplement the clearances specified in ANSI Z223.1. Local codes supersede these recommendations.

Terminals should be positioned to avoid products of combustion entering openings into buildings or other flues or vents.

- Avoid termination locations near a dryer vent.
- Avoid termination locations near commercial cooking exhaust.

